

Operational Performance of Power Plants 1/2

Energy Generation


[A]



The grid-connected plants recorded a Plant Availability Factor (PAF) of 40% - At any point during the month, an average of 5,506MW was available for dispatch unto the grid.


Grid Performance

[C]

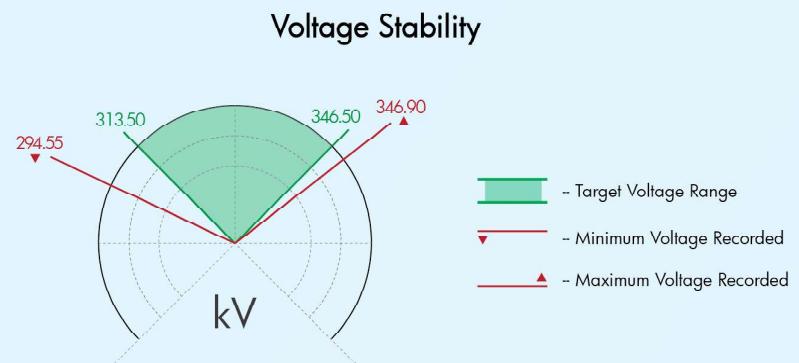


The average lower grid voltage (294.55kV) and average upper grid voltage (346.90kV) during the month exceeded the prescribed limits (313.50kV - 346.50kV).

[B]

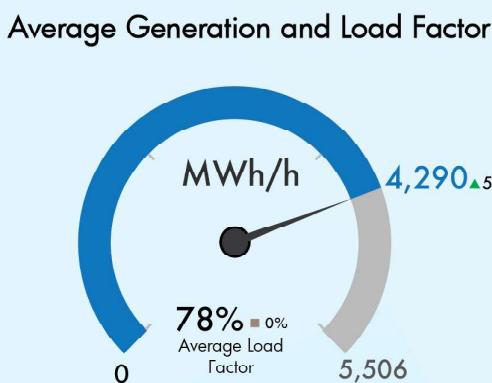

The average hourly generation during the month was 4,290MWh/h, indicating that only 78% of available generation capacity was utilised.

[D]

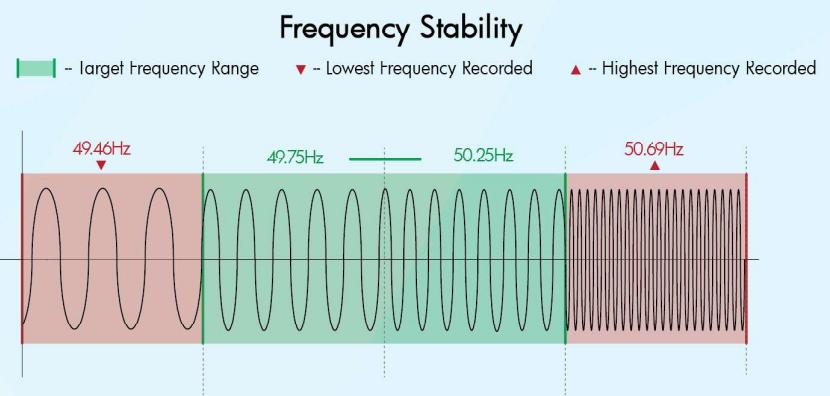

The average lower grid frequency (49.46Hz) and average upper grid frequency (50.69Hz) during the month exceeded the prescribed limits (49.75Hz - 50.25Hz).

■▲▼ - Relative change compared to previous month (September 2025)