




Energy Generation

[A]


Plant Availability

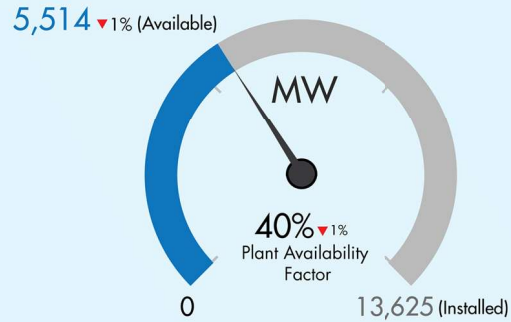

The grid-connected plants recorded a Plant Availability Factor (PAF) of 40% - At any point during the month, an average of 5,514MW was available for dispatch unto the grid.

[B]

Plant Utilization and Output

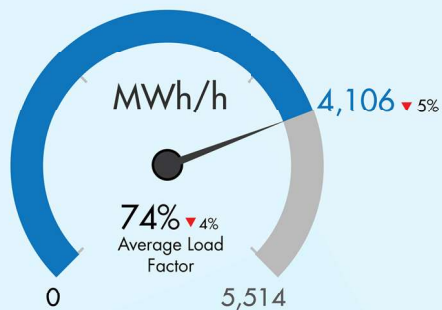


The average hourly generation during the month was 4,106MWh/h, indicating that only 74% of available generation capacity was utilised.

$\triangle \downarrow$ - Relative change compared to previous month (July 2025)

Grid Performance

[C]


Voltage Stability

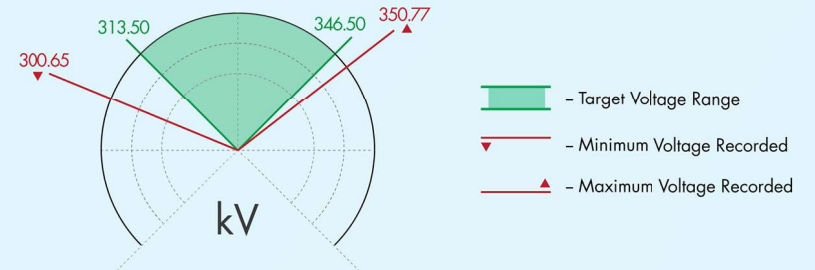

The average lower grid voltage (300.65kV) and average upper grid voltage (350.77kV) during the month exceeded the prescribed limits (313.50kV - 346.50kV)

[D]

Frequency Stability

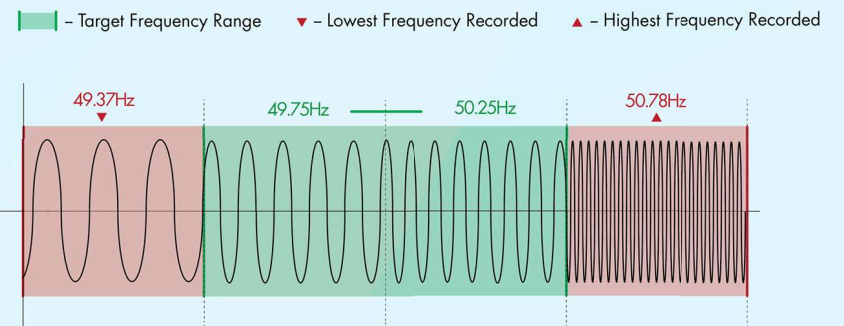

The average lower grid frequency (49.37Hz) and average upper grid frequency (50.78Hz) during the month exceeded the prescribed limits (49.75Hz - 50.25Hz)