



### Energy Generation

[A]


#### Plant Availability



The grid-connected plants recorded a Plant Availability Factor (PAF) of 38% - At any point during the month, an average of 5,151MW was available for dispatch unto the grid.

[B]

#### Average Generation and Load Factor

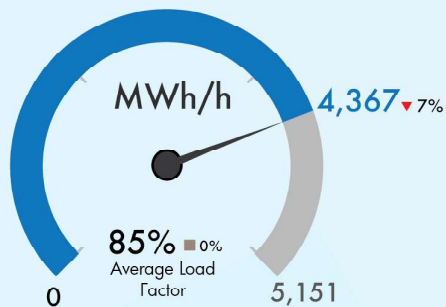

The average hourly generation during the month was 4,367MWh/h, indicating that only 85% of available generation capacity was utilised.


▲▼ - Relative change compared to previous month (November 2025)

\* This represents the gross installed capacity of the 28 grid connected plants reported in this factsheet

### Grid Performance

[C]


#### Voltage Stability

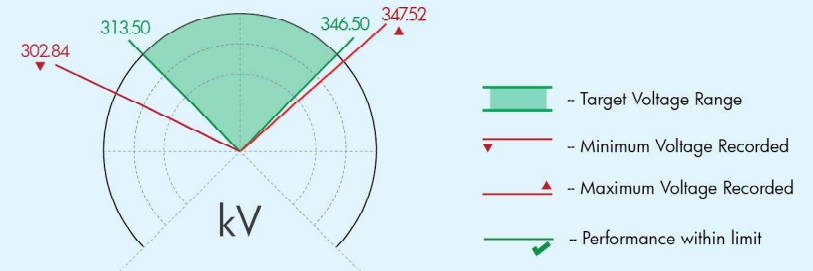

The monthly average lower grid voltage (302.84kV) and average upper grid voltage (347.52kV) during the month exceeded the prescribed limits (313.50kV - 346.50kV).

[D]

#### Frequency Stability

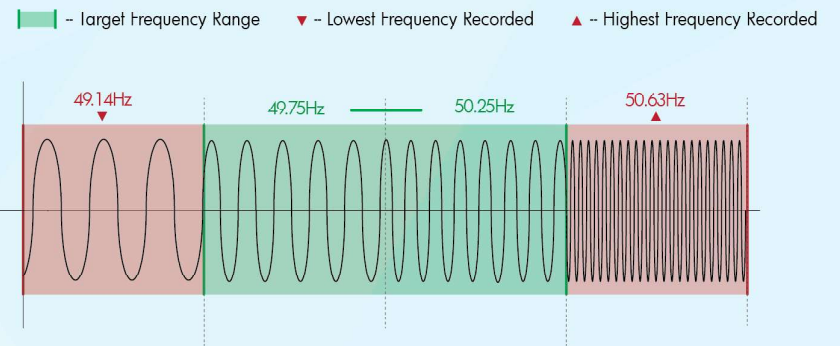

The average lower grid frequency (49.14Hz) and average upper grid frequency (50.63Hz) during the month exceeded the prescribed limits (49.75Hz - 50.25Hz)