




## Energy Generation

[A]


### Plant Availability

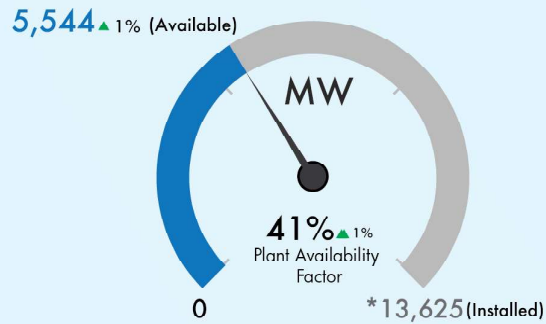

The grid-connected plants recorded a Plant Availability Factor (PAF) of 41% - At any point during the month, an average of 5,544MW was available for dispatch unto the grid.

[B]

### Average Generation and Load Factor

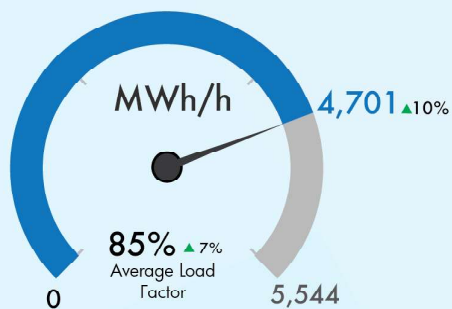

The average hourly generation during the month was 4,701MWh/h, indicating that only 85% of available generation capacity was utilised.


▲▼ - Relative change compared to previous month (October 2025)

\* This represents the gross installed capacity of the 28 grid connected plants reported in this factsheet

## Grid Performance

[C]


### Voltage Stability

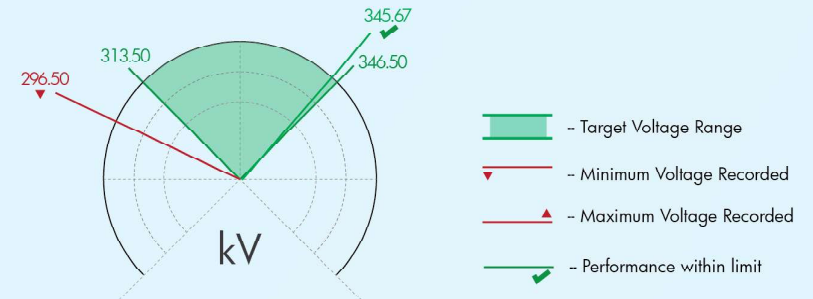

The monthly average lower grid voltage (296.50kV) exceeded the prescribed lower limit (313.50kV) while the average upper grid voltage (345.67kV) was within the prescribed higher limit (346.50kV)

[D]

### Frequency Stability

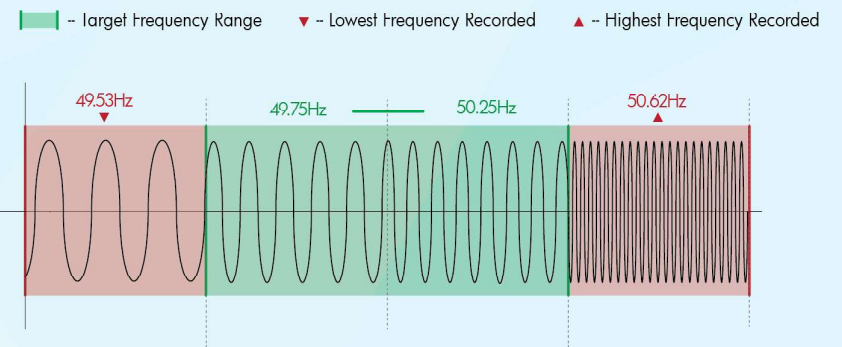

The average lower grid frequency (49.53Hz) and average upper grid frequency (50.62Hz) during the month exceeded the prescribed limits (49.75Hz - 50.25Hz)